



Control 20.11.21 - 11.12.21 = 15 Tage / Schrank 1 / KUBA HUMIDOR

	Sensirion			Boveda Butler			Haarhygrometer		Interner Sensor	
	RLF %	Grad Celsius		RLF %	Grad Celsius		RLF %	Grad Celsius	RLF %	Grad Celsius
20.11.21	69.56%	22.70		70.00%	23.0		73.0%	23.0	71.0%	-
22.11.21	70.65%	22.80		70.00%	23.0		73.0%	23.0	71.0%	-
23.11.21	70.30%	22.96		70.00%	23.0		73.0%	23.0	71.0%	-
24.11.21	70.63%	22.87		70.00%	23.0		73.0%	23.0	71.0%	-
27.11.21	70.39%	22.53		70.00%	23.0		73.0%	23.0	72.0%	-
29.11.21	70.14%	21.82		70.00%	23.0		74.0%	22.0	73.0%	-
30.11.21	70.56%	22.70		70.00%	23.0		73.0%	23.0	71.0%	-
01.12.21	70.76%	22.81		70.00%	23.0		73.0%	23.0	71.0%	-
02.12.21	70.94%	22.61		70.00%	23.0		73.0%	23.0	71.0%	-
04.12.21	71.40%	22.81		70.00%	23.0		73.0%	23.0	72.0%	-
06.12.21	71.97%	22.94		70.00%	23.0		70.0%	23.0	70.0%	-
07.12.21	71.89%	22.39		70.00%	23.0		70.0%	23.0	71.0%	-
08.12.21	70.11%	22.05		70.00%	23.0		69.0%	22.0	68.0%	-
09.12.21	71.59%	21.58		70.00%	23.0		70.0%	21.0	68.0%	-
11.12.21	70.81%	21.33		70.00%	23.0		70.0%	21.0	69.0%	-
Gelüftet auf 69%										
Kalibriert: In. + H.										

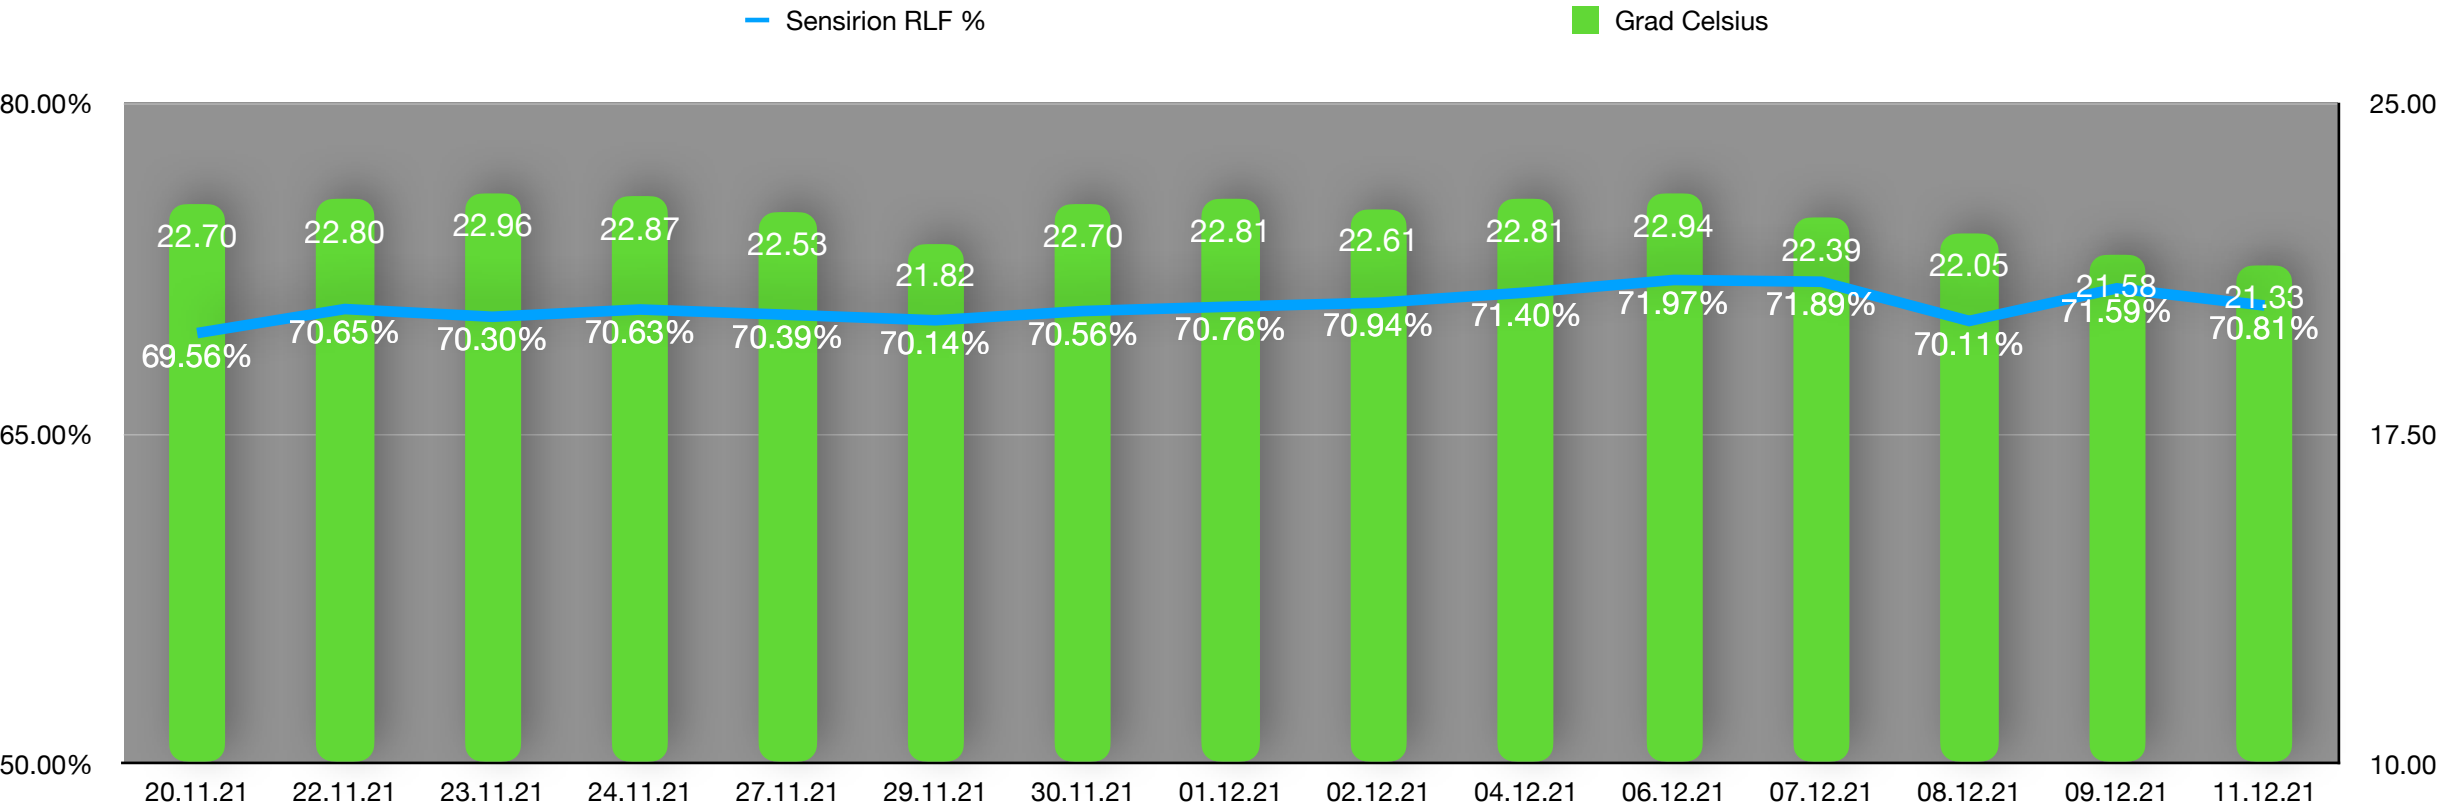


Control 20.11.21 - 11.12.21 = 15 Tage / Schrank 2 / KUBA HUMIDOR

	Sensirion			Boveda Butler			Haarhygrometer		Interner Sensor	
	RLF %	Grad Celsius		RLF %	Grad Celsius		RLF %	Grad Celsius	RLF %	Grad Celsius
20.11.21	67.31%	22.70		72.0%	23.0		73.0%	22.0	71.0%	-
22.11.21	68.22%	22.81		72.0%	23.0		73.0%	23.0	72.0%	-
23.11.21	68.59%	22.90		72.0%	23.0		73.0%	23.0	73.0%	-
24.11.21	69.02%	22.82		72.0%	23.0		74.0%	23.0	73.0%	-
27.11.21	70.36%	22.66		72.0%	23.0		75.0%	23.0	74.0%	-
29.11.21	70.76%	21.80		72.0%	23.0		74.0%	22.0	73.0%	-
30.11.21	70.59%	22.60		72.0%	23.0		75.0%	23.0	74.0%	-
01.12.21	70.88%	22.71		72.0%	23.0		74.0%	22.0	75.0%	-
02.12.21	70.69%	22.60		72.0%	23.0		74.0%	22.0	74.0%	-
04.12.21	71.19%	22.82		72.0%	23.0		74.0%	22.0	75.0%	-
06.12.21	71.34%	22.96		72.0%	23.0		73.0%	24.0	70.0%	-
07.12.21	71.36%	22.44		72.0%	23.0		70.0%	23.0	71.0%	-
08.12.21	69.47%	22.09		72.0%	23.0		68.0%	21.0	68.0%	-
09.12.21	71.35%	21.66		72.0%	23.0		70.0%	21.0	69.0%	-
11.12.21	69.99%	21.56		72.0%	23.0		69.0%	20.0	68.0%	-
Gelüftet auf 69%										
Kalibriert: In. + H.										

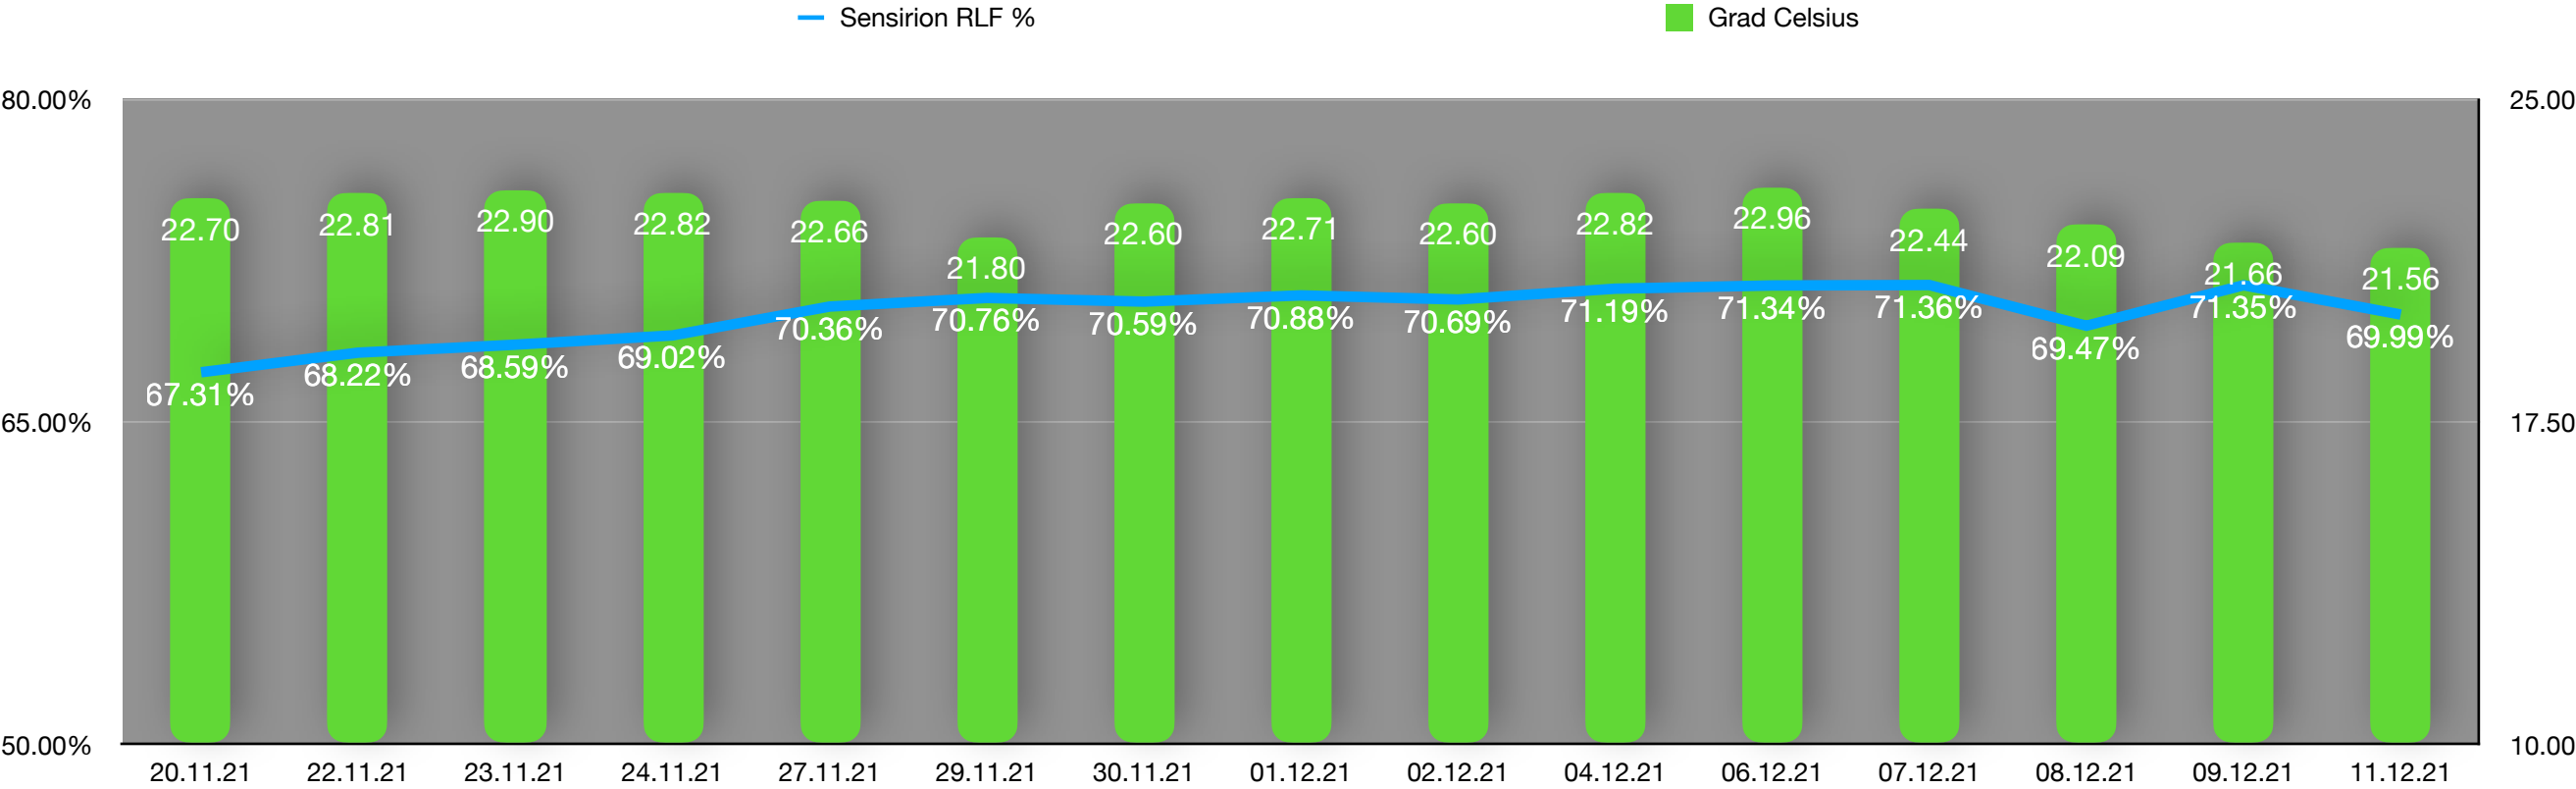


Control 20.11.21 - 11.12.21 = 15 Tage / Schrank 3 / NON KUBA

	Sensirion			Boveda Butler		Haarhygrometer		Interner Sensor	
	RLF %	Grad Celsius		RLF %	Grad Celsius	RLF %	Grad Celsius	RLF %	Grad Celsius
20.11.21	69.10%	22.56		71.0%	22.0	-%	-	72.0%	-
22.11.21	69.44%	22.82		71.0%	22.0	-%	-	71.0%	-
23.11.21	69.12%	22.92		71.0%	22.0	-%	-	72.0%	-
24.11.21	68.64%	22.83		71.0%	22.0	-%	-	72.0%	-
27.11.21	72.37%	21.69		71.0%	22.0	-%	-	74.0%	-
29.11.21	72.60%	21.78		71.0%	22.0	-%	-	74.0%	-
30.11.21	73.13%	22.59		71.0%	22.0	-%	-	74.0%	-
01.12.21	73.61%	22.60		71.0%	22.0	-%	-	75.0%	-
02.12.21	71.90%	22.45		71.0%	22.0	-%	-	74.0%	-
04.12.21	72.61%	22.71		71.0%	22.0	-%	-	74.0%	-
06.12.21	69.49%	22.80		71.0%	22.0	73.0%	24.0	70.0%	-
07.12.21	71.88%	22.38		71.0%	22.0	73.0%	24.0	71.0%	-
08.12.21	72.35%	22.10		71.0%	22.0	73.0%	24.0	72.0%	-
09.12.21	73.07%	21.65		71.0%	22.0	76.0%	24.0	72.0%	-
11.12.21	72.96%	21.11		71.0%	22.0	74.0%	23.0	73.0%	-
Kalibriert: In. + H.									

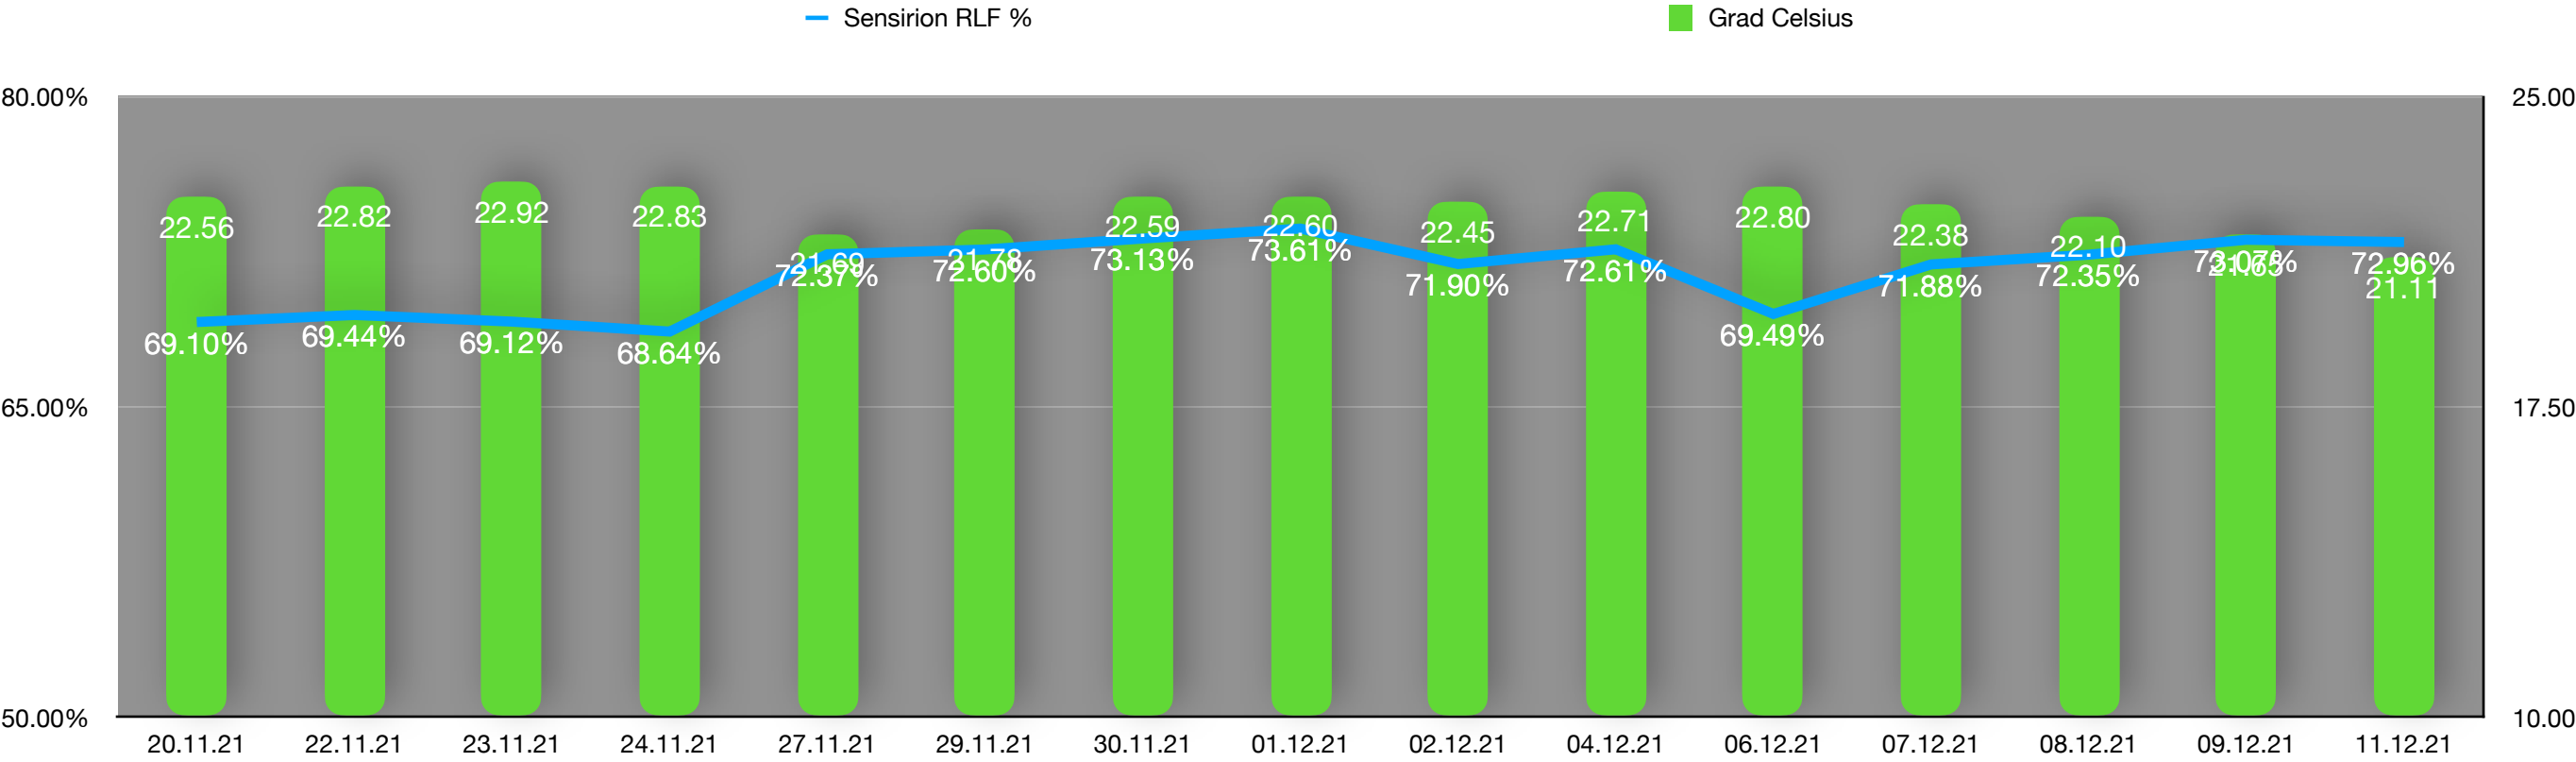


Control 20.11.21 - 11.12.21 = 15 Tage / Schrank 4 / NON KUBA

	Sensirion			Boveda Butler			Haarhygrometer		Interner Sensor	
	RLF %	Grad Celsius		RLF %	Grad Celsius		RLF %	Grad Celsius	RLF %	Grad Celsius
20.11.21	70.72%	22.71		74.0%	23.0		72.0%	24.0	73.0%	-
22.11.21	71.83%	22.91		74.0%	23.0		71.0%	24.0	74.0%	-
23.11.21	72.11%	23.04		74.0%	23.0		72.0%	24.0	74.0%	-
24.11.21	72.32%	22.99		74.0%	23.0		71.0%	23.0	74.0%	-
27.11.21	73.96%	22.76		74.0%	23.0		73.0%	24.0	74.0%	-
29.11.21	74.24%	21.96		74.0%	23.0		73.0%	24.0	74.0%	-
30.11.21	74.20%	22.67		74.0%	23.0		74.0%	24.0	75.0%	-
01.12.21	74.64%	22.71		74.0%	23.0		73.0%	24.0	75.0%	-
02.12.21	74.65%	22.60		74.0%	23.0		73.0%	24.0	75.0%	-
04.12.21	75.09%	22.81		74.0%	23.0		74.0%	24.0	76.0%	-
06.12.21	74.30%	23.10		74.0%	23.0		72.0%	24.0	74.0%	-
07.12.21	74.66%	22.56		74.0%	23.0		73.0%	24.0	74.0%	-
08.12.21	70.70%	22.11		74.0%	23.0		70.0%	23.0	70.0%	-
09.12.21	73.24%	21.81		74.0%	23.0		72.0%	24.0	73.0%	-
11.12.21	73.12%	22.95		74.0%	23.0		73.0%	24.0	73.0%	-
Gelüftet auf 70%										
Kalibriert: In. + H.										

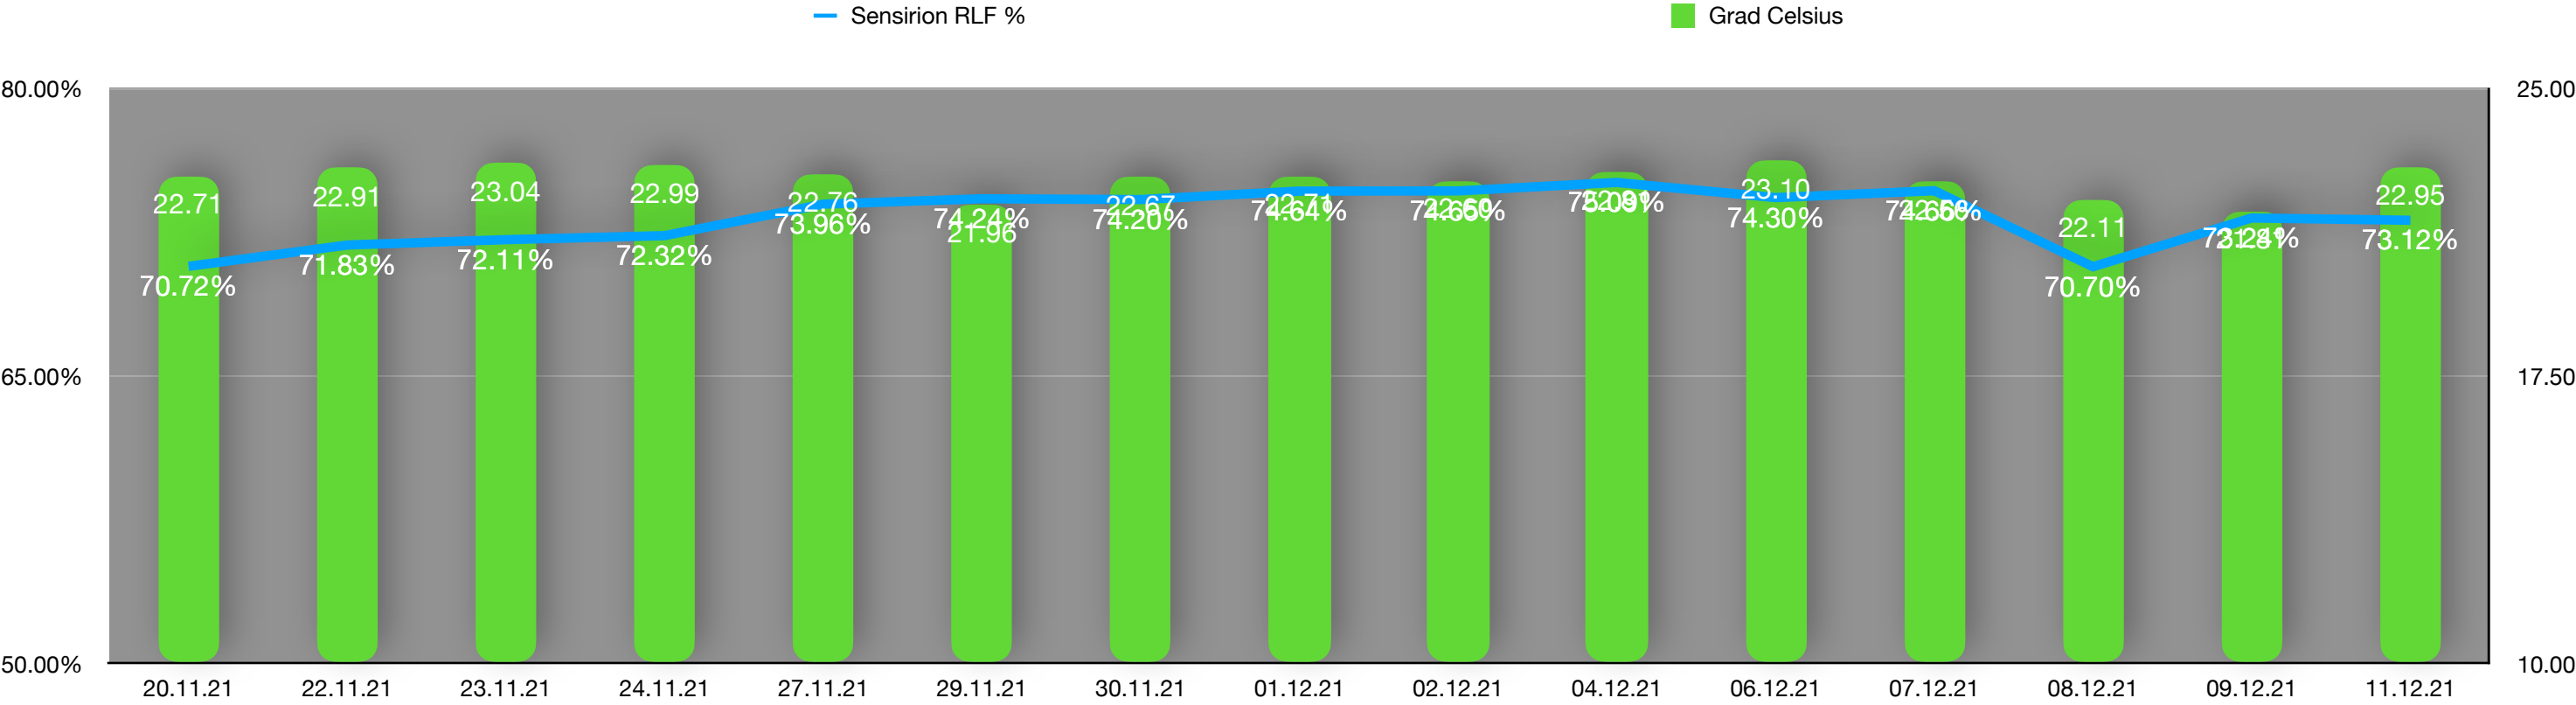


Control 20.11.21 - 11.12.21 = 15 Tage / Schrank 5 / NON KUBA

	Sensirion			Boveda Butler		Haarhygrometer		Interner Sensor	
	RLF %	Grad Celsius		RLF %	Grad Celsius	RLF %	Grad Celsius	RLF %	Grad Celsius
20.11.21	68.08%	22.82		74.0%	24.0	-%	-	71.0%	-
22.11.21	69.40%	22.99		72.0%	23.0	-%	-	71.0%	-
23.11.21	69.70%	23.08		72.0%	23.0	-%	-	72.0%	-
24.11.21	70.14%	23.04		72.0%	23.0	-%	-	72.0%	-
27.11.21	71.73%	22.78		72.0%	23.0	-%	-	72.0%	-
29.11.21	71.94%	22.00		72.0%	23.0	-%	-	74.0%	-
30.11.21	71.95%	22.65		72.0%	23.0	-%	-	74.0%	-
01.12.21	72.23%	22.70		72.0%	23.0	-%	-	74.0%	-
02.12.21	71.96%	22.64		72.0%	23.0	-%	-	73.0%	-
04.12.21	72.60%	22.85		72.0%	23.0	-%	-	74.0%	-
06.12.21	71.42%	23.13		72.0%	23.0	-%	-	74.0%	-
07.12.21	71.36%	22.67		72.0%	23.0	-%	-	70.0%	-
08.12.21	71.48%	22.36		72.0%	23.0	-%	-	71.0%	-
09.12.21	72.90%	21.93		72.0%	23.0	-%	-	73.0%	-
11.12.21	71.57%	21.51		72.0%	23.0	-%	-	72.0%	-
Gelüftet auf 70%									
Kalibriert: In. + H.									

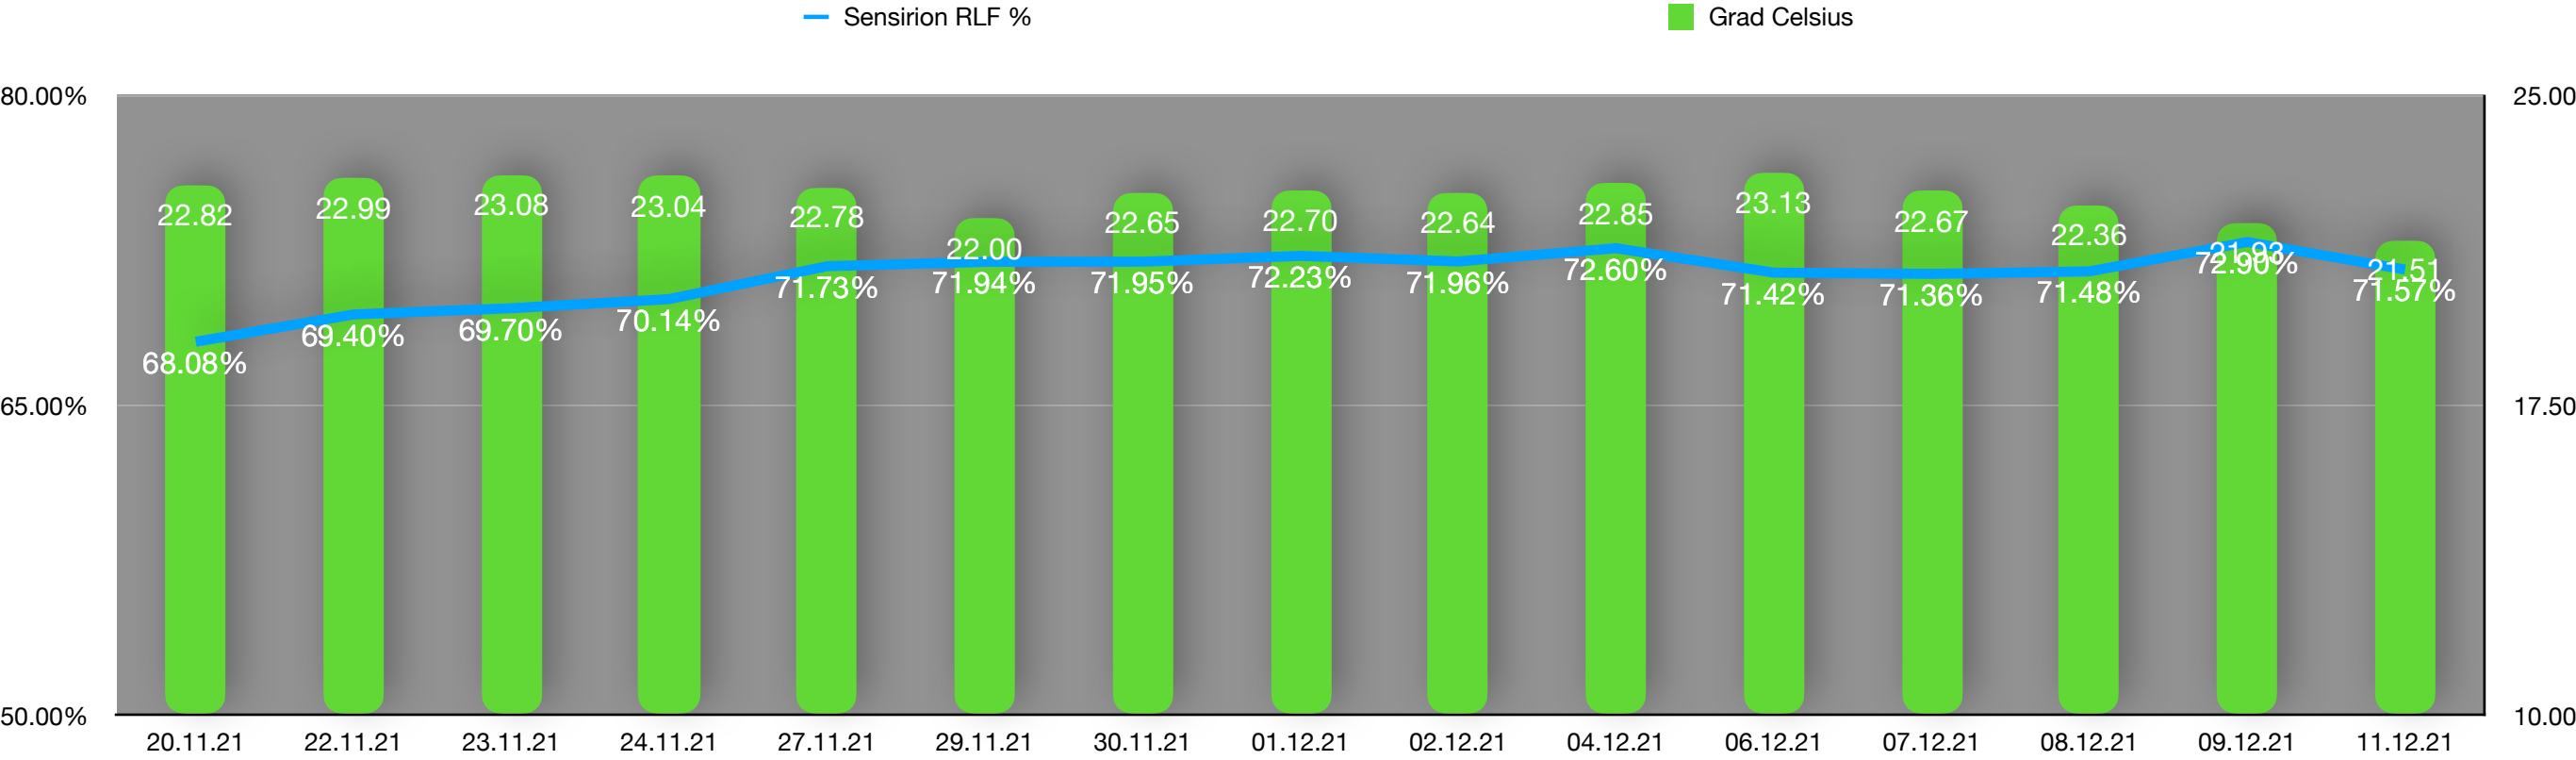

Control 20.11.21 - 11.12.21 = 15 Tage / Schrank 6 / 1/4 KUBA

	Sensirion			Boveda Butler			Haarhygrometer		Interner Sensor	
	RLF %	Grad Celsius		RLF %	Grad Celsius		RLF %	Grad Celsius	RLF %	Grad Celsius
20.11.21	72.42%	22.47		74.0%	24.0		80.0%	24.0	71.0%	-
22.11.21	74.13%	22.82		74.0%	24.0		78.0%	24.0	71.0%	-
23.11.21	70.91%	22.86		74.0%	24.0		76.0%	24.0	70.0%	-
24.11.21	69.57%	23.32		74.0%	24.0		75.0%	24.0	69.0%	-
27.11.21	73.56%	22.61		74.0%	24.0		73.0%	24.0	72.0%	-
29.11.21	74.26%	22.01		74.0%	24.0		74.0%	24.0	72.0%	-
30.11.21	74.24%	22.47		74.0%	24.0		72.0%	24.0	72.0%	-
01.12.21	74.39%	22.49		74.0%	24.0		72.0%	24.0	72.0%	-
02.12.21	74.69%	22.42		74.0%	24.0		74.0%	25.0	73.0%	-
04.12.21	74.97%	22.68		74.0%	24.0		72.0%	24.0	73.0%	-
06.12.21	73.90%	22.99		74.0%	24.0		-%	-	73.0%	-
07.12.21	73.90%	22.47		74.0%	24.0		-%	-	74.0%	-
08.12.21	70.12%	22.42		74.0%	24.0		-%	-	70.0%	-
09.12.21	72.90%	21.83		74.0%	24.0		-%	-	71.0%	-
11.12.21	72.16%	21.63		74.0%	24.0		-%	-	72.0%	-
Gelüftet auf 69%										
Kalibriert: Intern										

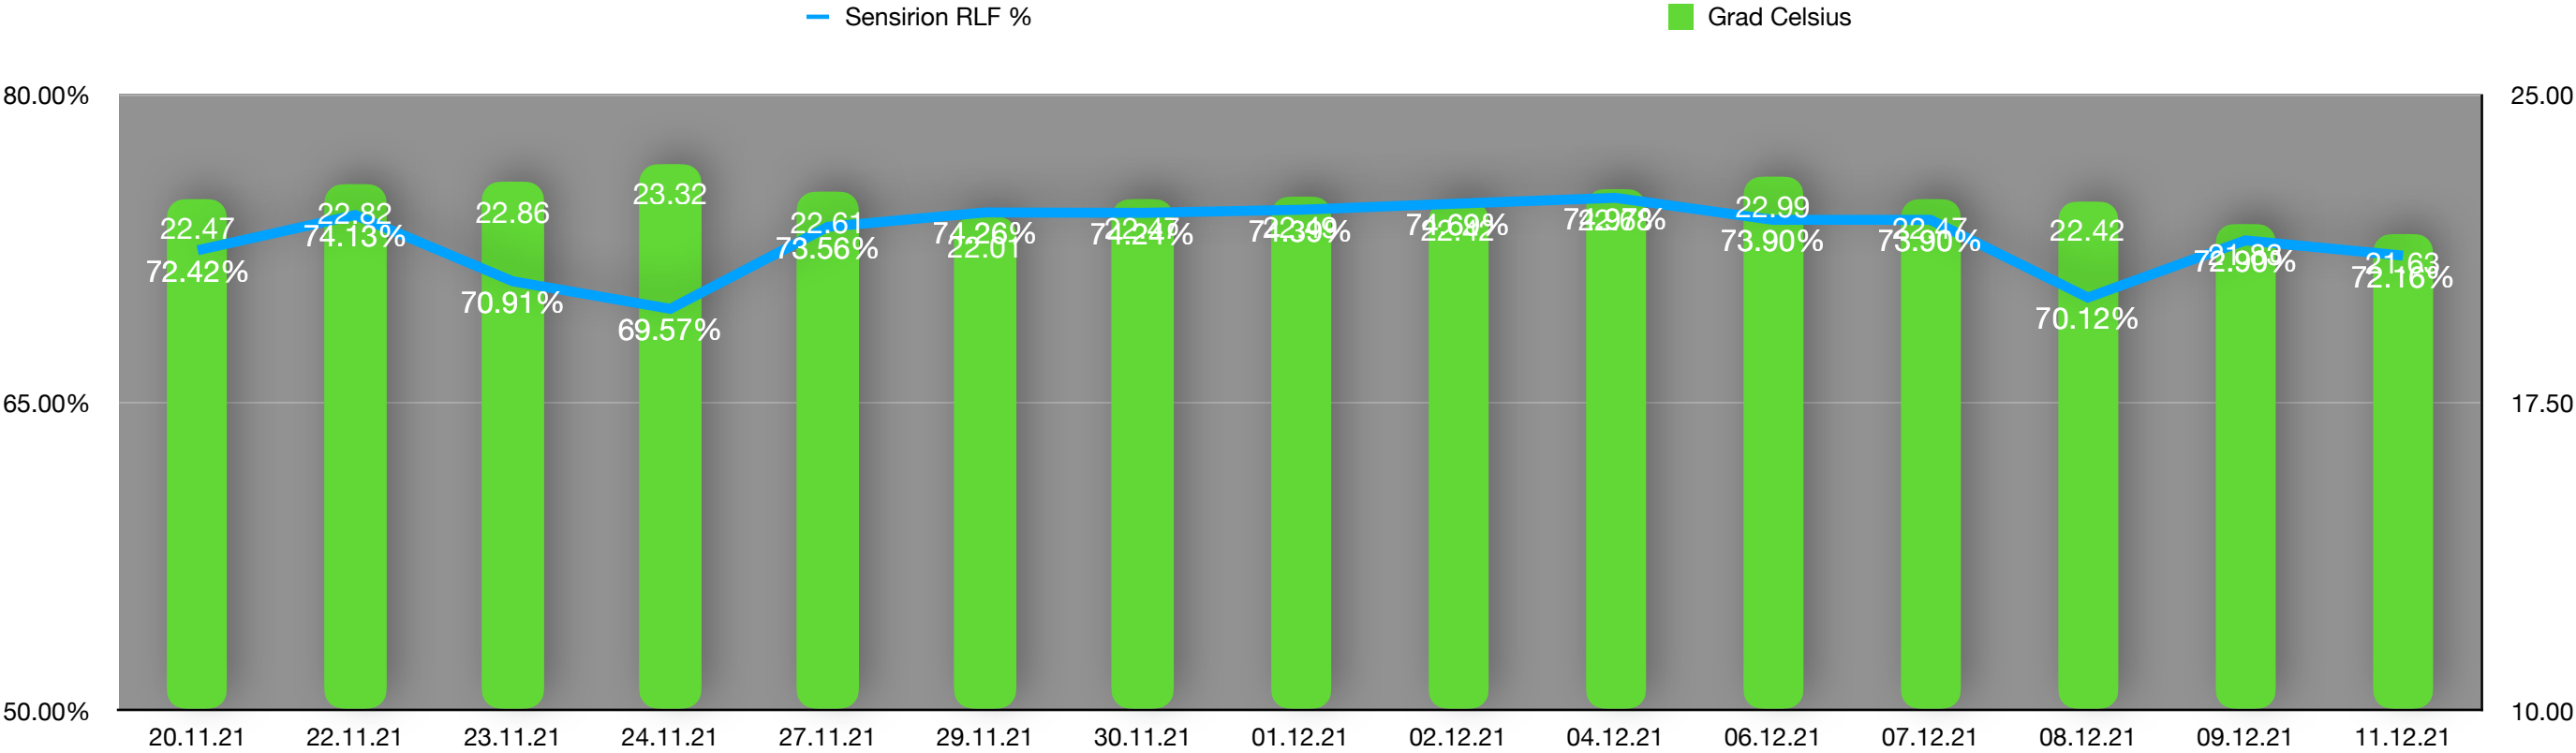

Control 20.11.21 - 11.12.21 = 15 Tage / Schrank 7 / 1/2 KUBA

	Sensirion			Boveda Butler		Haarhygrometer		Interner Sensor	
	RLF %	Grad Celsius		RLF %	Grad Celsius	RLF %	Grad Celsius	RLF %	Grad Celsius
20.11.21	68.87%	22.54		69.0%	22.0	-%	-	72.0%	-
22.11.21	70.25%	22.72		69.0%	22.0	-%	-	73.0%	-
23.11.21	70.55%	22.82		69.0%	22.0	-%	-	73.0%	-
24.11.21	70.81%	22.78		69.0%	22.0	-%	-	74.0%	-
27.11.21	72.04%	22.42		69.0%	22.0	-%	-	74.0%	-
29.11.21	72.42%	21.70		69.0%	22.0	-%	-	74.0%	-
30.11.21	72.44%	22.29		69.0%	22.0	-%	-	75.0%	-
01.12.21	72.70%	22.34		69.0%	22.0	-%	-	75.0%	-
02.12.21	72.50%	22.26		69.0%	22.0	-%	-	75.0%	-
04.12.21	73.29%	22.59		69.0%	22.0	-%	-	75.0%	-
06.12.21	73.13%	22.83		69.0%	22.0	-%	-	73.0%	-
07.12.21	73.29%	22.38		69.0%	22.0	-%	-	73.0%	-
08.12.21	70.91%	22.03		69.0%	22.0	-%	-	71.0%	-
09.12.21	73.19%	21.69		69.0%	22.0	-%	-	71.0%	-
11.12.21	72.59%	22.81		69.0%	22.0	-%	-	73.0%	-
Gelüftet auf 69%									
Kalibriert: Intern									

